


# I.S. GEOPHONE NETWORK INSTALLATION DIAGRAM

**HAZARDOUS AREA**

**SAFE AREA**

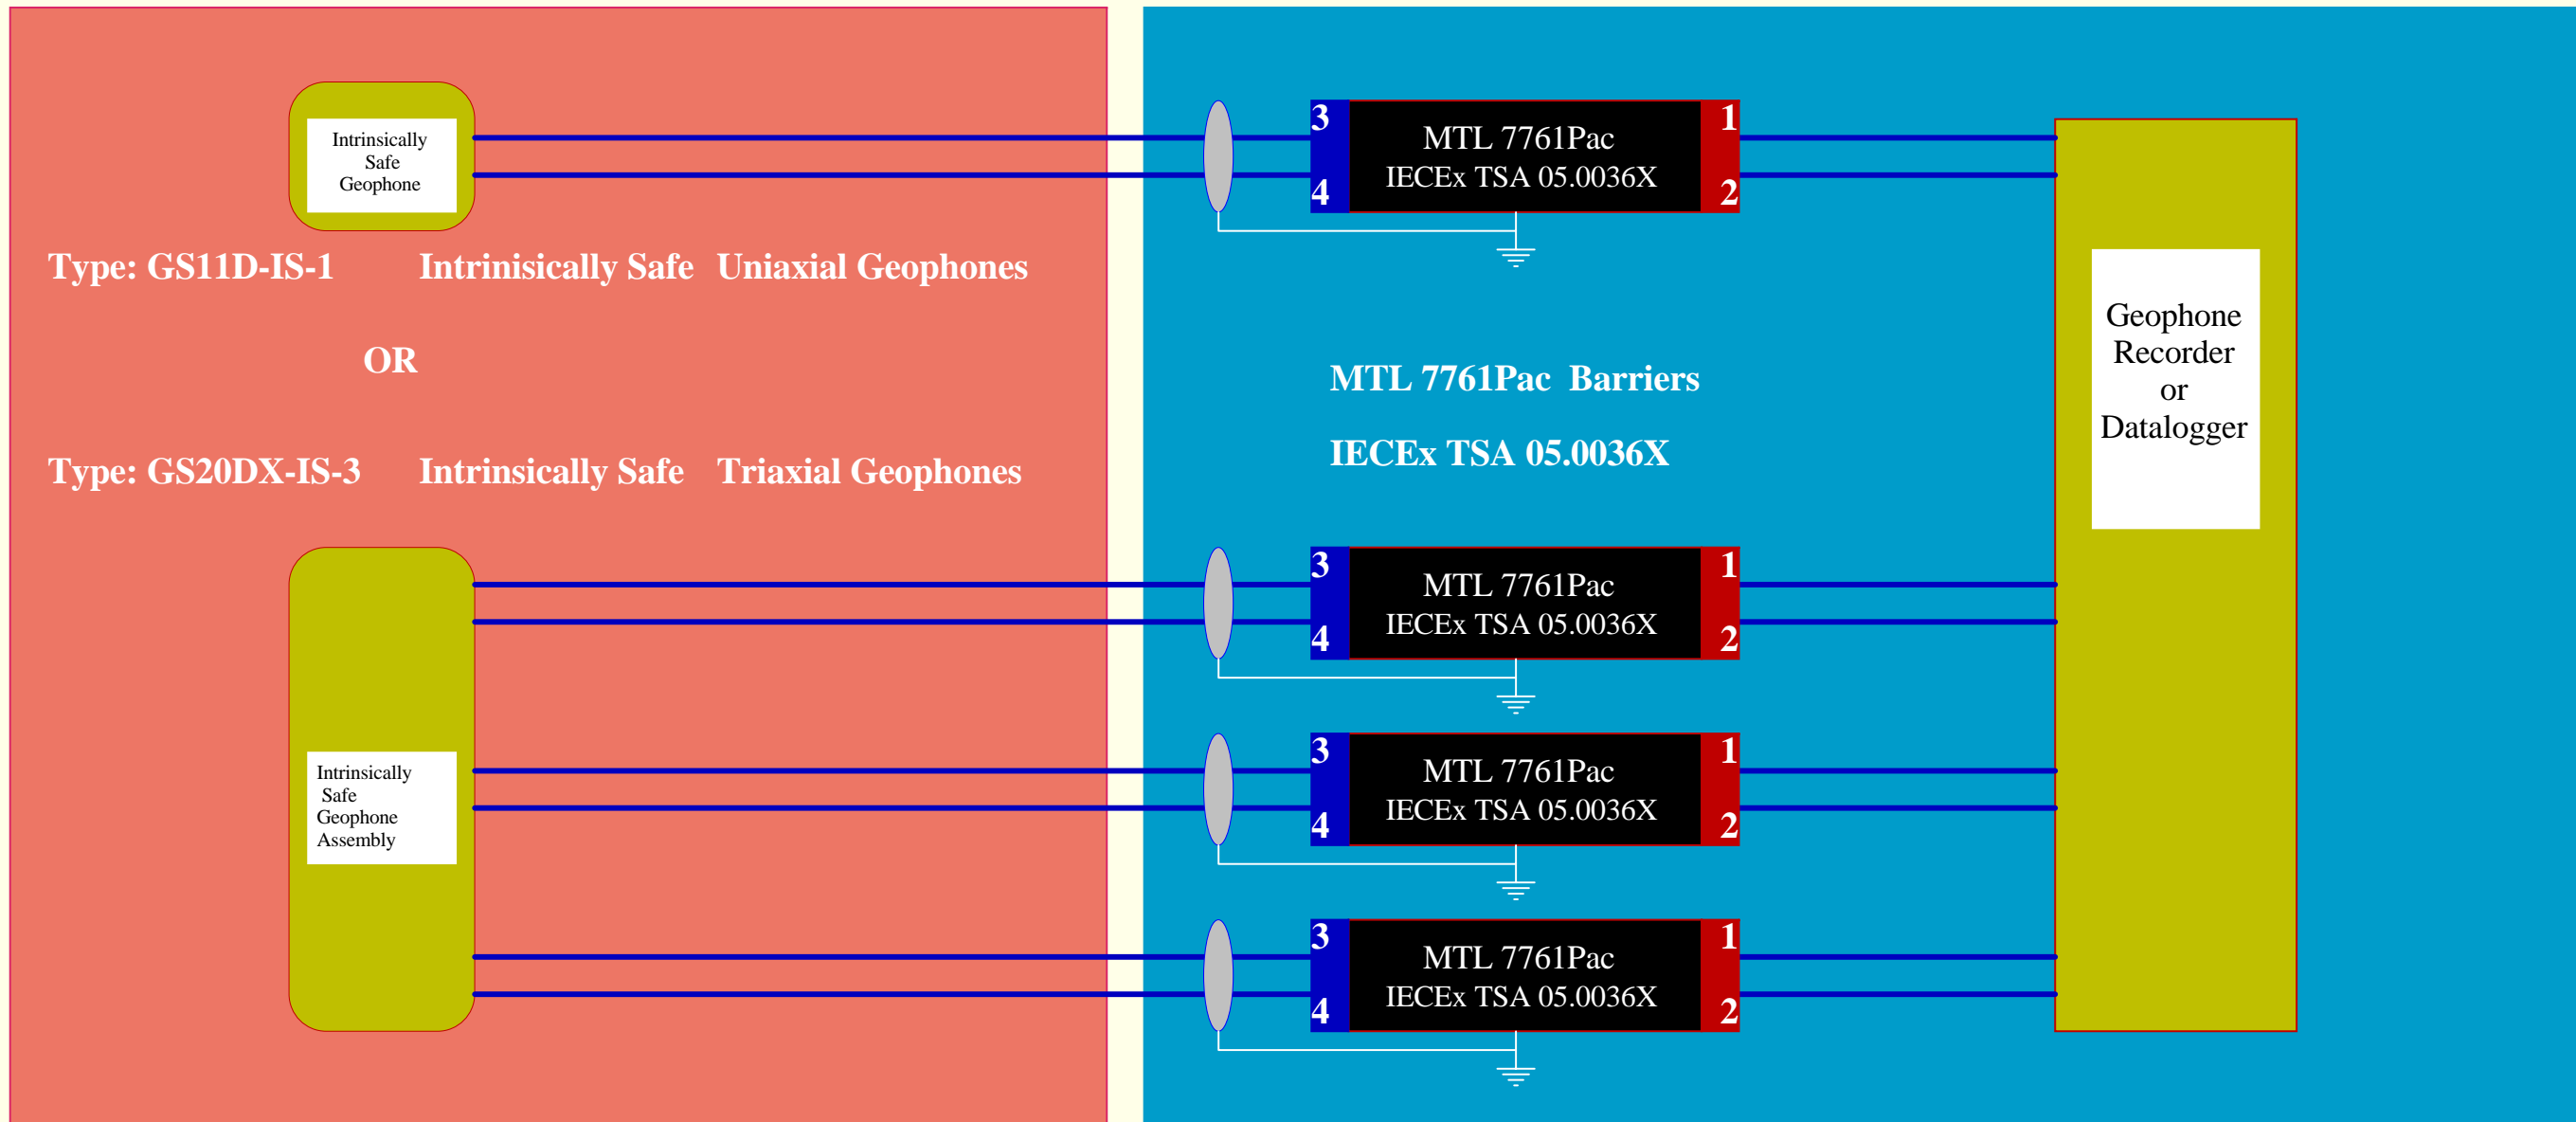

**HAZARDOUS AREA Cable**

For uniaxial geophones use:

1 x Twisted pair, screened, and drain wire

For triaxial geophones use:

3 x Twisted pair, individually screened, and drain wires

**SAFE AREA Cable**

Unspecified twisted pair

(Holville Dwg No. 100659)

Title I.S. Geophone Network Installation Diagram			
Size A3	Number ISG 3	Revision 4	
Date: 21-Oct-2010	Sheet 1 of 1		Drawn By: Ron McPhee
File: Q:\Ron McPhee\IS Geophone.ddb			